

SEC 3000 Gas Detector

Instruction and Operation Manual

**Sensor Electronics Corporation
12730 Creek View Avenue
Savage, Minnesota 55378 USA
(952) 938-9486 Fax (952) 938-9617
Email: sales@sensorelectronics.com
Web site: www.sensorelectronics.com**

Part Number 1460003, Rev C

Commitment

Our quality and service are uncompromising. We back each of our products with a two-year warranty on all materials and workmanship. We offer technical support, user training and on-site service and maintenance of equipment to meet the needs of our customers.

Gas Detection Service

Individually designed maintenance packages are available for specific customer needs. Service begins with verification of the system installation that includes an initial system check and calibration. We then offer customer training programs (on-site and at factory) to ensure that technical personnel fully understand operation and maintenance procedures. When on-the-spot assistance is required, service representatives are available to handle any questions or problems immediately.

WARRANTY

SENSOR ELECTRONICS CORPORATION (SEC) WARRANTS PRODUCTS MANUFACTURED BY SEC TO BE FREE FROM DEFECTS IN WORKMANSHIP AND MATERIALS FOR A PERIOD OF TWO (2) YEARS FROM DATE OF SHIPMENT FROM THE FACTORY. ANY PARTS RETURNED FREIGHT PRE-PAID TO THE FACTORY AND FOUND DEFECTIVE WITHIN THE WARRANTY WOULD BE REPAIRED OR REPLACED, AT SEC'S OPTION. SEC WILL RETURN REPAIRED OR REPLACED EQUIPMENT PRE-PAID LOWEST COST FREIGHT. THIS WARRANTY DOES NOT APPLY TO ITEMS, WHICH BY THEIR NATURE ARE SUBJECT TO DETERIORATION OR CONSUMPTION IN NORMAL SERVICE. SUCH ITEMS MAY INCLUDE:

**CHEMICAL SENSOR ELEMENTS
FUSES AND BATTERIES.**

WARRANTY IS VOIDED BY ABUSE INCLUDING ROUGH HANDLING, MECHANICAL DAMAGE, ALTERATION OR REPAIR. THIS WARRANTY COVERS THE FULL EXTENT OF SEC LIABILITY AND SEC IS NOT RESPONSIBLE FOR REMOVAL, REPLACEMENT COSTS, LOCAL REPAIR COSTS, TRANSPORTATION COSTS OR CONTINGENT EXPENSES INCURRED WITHOUT PRIOR WRITTEN APPROVAL. SENSOR ELECTRONICS CORPORATION'S OBLIGATION UNDER THIS WARRANTY SHALL BE LIMITED TO REPAIR OR REPLACEMENT OF ANY PRODUCT THAT HAS BEEN RETURNED TO SENSOR ELECTRONICS CORPORATION FOR WARRANTY CONSIDERATION. THIS WARRANTY IS EXPRESSLY IN LIEU OF ANY AND ALL OTHER WARRANTIES EXPRESSED OR IMPLIED, AND ALL OTHER OBLIGATIONS OR LIABILITIES ON THE PART OF SENSOR ELECTRONICS CORPORATION INCLUDING BUT NOT LIMITED TO, THE FITNESS FOR A PARTICULAR PURPOSE. IN NO EVENT SHALL SENSOR ELECTRONICS CORPORATION BE LIABLE FOR DIRECT, INCIDENTAL, OR CONSEQUENTIAL LOSS OR DAMAGE OF ANY KIND CONNECTED WITH THE USE OF IT'S PRODUCTS OR FAILURE TO FUNCTION OR OPERATE PROPERLY.



READ AND UNDERSTAND THE USER'S MANUAL BEFORE OPERATING OR SERVICING

LISEZ ET COMPRENEZ LE MANUEL DE L'UTILISATEUR AVANT D'UTILISER OU D'ENTREtenir



WARNING: OPEN CIRCUIT BEFORE REMOVING COVER
OUVRIR LE CIRCUIT AVANT D'ENLEVER LE COUVERCLE



CAUTION: FOR SAFETY REASONS THIS EQUIPMENT MUST BE OPERATED AND SERVICED BY QUALIFIED PERSONEL ONLY
ATTENTION : POUR DES RAISONS DE SÉCURITÉ, CET ÉQUIPEMENT DOIT ÊTRE UTILISÉ ET RÉPARÉ UNIQUEMENT PAR DU PERSONNEL QUALIFIÉ

Revision History

Rev	ECO	Date	Description of Change	Page
C	000335	Apr 2023	Update Separation Kit Drawing	12
			Remove Cross gas table, it was created when only ATI cells were used, but since so many other cells are now used, the table is no longer accurate	10
B	000314	Mar 2022	Add altitude specification	4
			Add note about indoor use only	5
A	000213	Aug 2015	Assign new part number, place under ECO control	All (footer)
			Correct Temp Specifications to align with certifications	4
			Add Caution and Warning Statements	2
			Remove Y2K Disclaimer (obsolete)	1
31015		Oct 2013	Part Number 75-3000 Update Company Address	Cover
091404		Sep 2004	Revision History Undocumented	

Table of Contents

Revision History	3
I. SPECIFICATIONS	4
II GENERAL DESCRIPTION	5
III. OPERATION	6
IV. CALIBRATION	8
V. MAINTENANCE	9
VI. Parts List	9
VII. Drawing Section.....	10
Part Number Construction	12

I. SPECIFICATIONS

Model: SEC 3000 Gas Detector
Model Number: SEC 3000

Available gases:

Ammonia	Carbon Monoxide	Hydrogen
Nitric Oxide	Oxygen	Phosgene
Bromine	Chlorine	Chlorine Dioxide
Fluorine	Hydrogen Peroxide	Ozone
Hydrogen Chloride	Hydrogen Cyanide	Hydrogen Fluoride
Hydrogen Sulfide	Nitrogen Dioxide	Sulfur Dioxide
Arsine	Diborane	Germane
Hydrogen Selenide	Phosphine	Silane
Formaldehyde		

Please note that this list is not all-inclusive. The SEC 3000 sensors can be calibrated for other toxic gases provided a calibration gas is available. For more please contact Sensor Electronics Corporation.

Detection Method: Electrochemical or Galvanic

Aspiration:

Diffusion

Optional Sample Draw (requires 1 liter per minute sample flow rate)

Output (Analog): 4-20 mA (Source type), max. 1000 Ohm load at 24 VDC supply voltage

Output (Digital) Interactive Interface Available On The Calibration (White) Wire

Response Time: Varies for type of sensing element

Construction: 316 Stainless Steel Explosion Proof

Accuracy: +/- 5%

Operating Temperature Rating (Ta): -40° to +50°C at 0 to 99% RH (non-condensing)

Operating Voltage (Explosion-Proof): \equiv 18 to 32 VDC measured at the detector head

Operating Voltage (Intrinsically Safe): See Intrinsically Safe Rating

Max. Current Draw: 55 mA (at 24 VDC)

Altitude: Up to 2000m

Weight: 0.5kg

Approvals:

Explosion Proof	CSA c,us: Class I, Division 1, Groups B,C,D	T6						
	IECEX CSA 13.0037: Ex d IIB+H2 T4 Gb							
Intrinsically Safe	CSA c,us: Cl I, Division 1, Groups	Vmax	Imax	Pmax	Ci	Li	T-Code	
	ABCD	10.4V	148mA	1.2W	2.51uF	22.5uH	T4	
	CD	16.4V	148mA	1.2W	2.51uF	22.5uH	T4	
	D	26.3V	148mA	1.2W	2.51uF	22.5uH	T4	
	IECEX CSA 13.0037: Ex ia IIC T4 Ga							

Installation Category: Cat. I, Pollution Degree 2, Overvoltage II

II GENERAL DESCRIPTION

CONVENTIONS

The following conventions are used in this manual.



Warning Statement



VDC (DC Voltage)

SEC 3000

The SEC 3000 toxic gas detector is a microprocessor based intelligent gas detector that continuously monitors toxic gases and vapors ideally suited for use in harsh environments.

The SEC 3000 is a stand-alone device providing a continuous 4 to 20 mA output.

Intrinsically Safe and Explosion Proof versions are available.

When operated with the appropriate Intrinsic Barrier, the IS SEC 3000 allows cover removal and sensor replacement without declassifying the area.

Each sensor comes calibrated and carries all operating parameters. Simply plugging the sensor board into any SEC 3000 base results in a calibrated fully functional unit.

The SEC 3000 is approved for indoor use only.



WARNING: SUBSTITUTION OF COMPONENTS MAY IMPAIR INTRINSIC SAFETY



AVERTISSEMENT: LA SUBSTITUTION DE COMPOSANTS PEUT COMPROMETTRE LA SECURITE INTRINSEQUE

Features

- *Compact low cost design*
- *No field gas calibration required*
- *Intrinsically Safe and explosion proof*
- *Universal control board*
- *Interchangeable sensor modules for oxygen and toxic gases*
- *Temperature compensated sensor*
- *Stand alone gas detector with 4-20 mA sourced output*
- *Corrosion resistant 316 stainless steel housing construction*
- *Long life electrochemical sensors*
- *Optional heater with closed loop temperature control ensures accuracy in low temperature applications*

Can Be Coupled With SEC 3100/3120 Transmitter to Provide

- *Alarm and Fault Relays*
- *Isolated RS485 Modbus Interface*
- *Lighted LCD Display*
- *Magnetic Switches For Unit Calibration Configuration*

III. OPERATION

Installation and Startup



Warning: The user shall be made aware that if the equipment is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.

The first step in the installation process is to establish a mounting location for the SEC 3000. Select a location that is typical of the atmosphere to be monitored or close to the anticipated source of a dangerous gas.

It is very important that the SEC 3000 be properly located to enable it to provide maximum protection. The most effective number and placement of sensors vary depending on the conditions of the application. When determining where to locate sensors the following factors should be considered.

- What are the characteristics of the gas that is to be detected? Is it lighter or heavier than air? If it is lighter than air the sensor should be placed above the potential gas leak. Place the sensor close to the floor for gases that are heavier than air or for vapors resulting from liquid spills. Note that air currents can cause a gas that is heavier than air to rise. In addition, if the temperature of the gas is hotter than ambient air or mixed with gases that are lighter than air, it could also rise.
- How rapidly will the gas diffuse into the ambient air? Select a location for the sensor that is close to the anticipated source of a gas leak.
- Wind or ventilation characteristics of the immediate area must also be considered. Movement of air may cause gas to accumulate more heavily in one area than in another. The detector should be placed in the areas where the most concentrated accumulation of gas is anticipated. For outdoor applications with strong wind conditions, it may require the sensors to be mounted closer together and on the down wind side, to the anticipated area of a gas leak. Also take into consideration for indoor applications, the fact that many ventilation systems do not operate continuously.
- The sensor should be accessible for maintenance.
- Excessive heat or vibration can cause premature failure of any electronic device and should be avoided if possible.
- Follow all national and local installation codes and practices.

The SEC 3000 has a $\frac{3}{4}$ " NPT threaded connector for mounting the detector to a junction box. SEC can provide a junction box with terminals for this purpose. $\frac{3}{4}$ NPT threads must pass L1 thread/plug gauge.

A user-supplied junction box can be used providing it has the appropriate sized NPT conduit entries. The junction box must be suitable for use in the application and location in which it is being installed. After the device has been installed, a calibration is required. Refer to the Calibration section of this manual.

The SEC 3000 can be used with an optional heater (installed at factory) in low temperature applications. This is a closed loop heater that will turn on until a target temperature is reached. This feature has been approved for use in hazardous locations.

Wiring connections

Red wire: 18 to 32 VDC \equiv

Black wire: DC Common

Blue wire: 4 to 20 mA output

White wire: Smart Calibration Wire (data wire)

Earth Ground: Two (2) grounding screws on SEC 3000 housing.

Wire sizing:

0 to 500 feet, recommended wire gauge size 16 AWG
501 to 1000 feet, recommended wire gauge size 14 AWG

Shielded cable is recommended. Wiring should be installed in metal conduit with no other cabling in the same conduit.

Wire Temperature Rating:

Greater than or equal to 70°C

Power Supply:

The SEC 3000 must be powered using a power supply rated for CAN/CSA C22.2 No. 61010-1-12 and ANSI/UL 61010-1 **OR** a class 2 power supply as defined in Canadian Electrical Code C22.1 Section 16-200 and/or National Electrical Code article 725.121.

Warm-up

When power is applied to the detector, it enters a one (1) minute warm-up mode. The output current will be 0.8 mA during the warmup time period. At the end of the warm-up period with no faults present, the detector automatically enters the normal operating mode (4 mA). If a fault is present after warm-up, the detector current output will indicate a fault. See the following chart for fault code status. Some electrochemical sensors will take up to 24 hours to stabilize. Newly installed sensors should be calibrated after they have been allowed to stabilize.

Normal

In the normal operating mode, the 4 to 20 mA signal levels correspond to the detected gas concentration. The detector continuously checks for system faults or initiation of calibration and automatically changes to the appropriate mode.

The 4 to 20 mA output of the SEC 3000 is a non-isolated current source.

Current Output and Corresponding Status

<u>Current Output</u>	<u>Status.</u>
0-20 mA	Normal measuring mode
0.0 mA	Unit Fault
0.8 mA	Unit warm up
1.2 mA	Zero drift fault
1.6 mA	Calibration fault
2.0 mA	Unit spanning
2.2 mA	Unit zeroing
4-20 mA	Normal measuring mode
4.0 mA	Zero gas level
5.6 mA	10% Full Scale
8.0 mA	25% Full Scale
12 mA	50% Full Scale
16 mA	75% Full Scale
20 mA	Full scale
>20 mA	Over-range

Once the fault is cleared the SEC 3000 will automatically resume normal operation.

IV. CALIBRATION

The SEC 3000 is factory calibrated, zeroed and spanned with calibration gas. After the SEC 3000 is installed under power for 24 hours it should be calibrated (zeroed and spanned) with calibration gas.

Calibration frequency is dependent on the application and installation requirements. Typical calibration of the gas sensors should be done on a quarterly basis.

The SEC 3000 sensor board is factory programmed with the following parameters. The parameters can be changed using the SEC 3000 PC Link software package. Refer the SEC 3000 PC Link Instruction Manual for additional information.

- Gas Type
- Range
- Calibration Gas
- Calibration Date
- Sensor Bias Voltage (Not Adjustable)

If the calibration gas concentration is known, the SEC 3000 sensor can be zeroed and spanned in the field. The SEC 3000 can also be calibrated using the SEC 3000 PC Link software package. Refer the SEC 3000 PC Link Instruction Manual for additional information.

Hardwire Calibration Method (For declassified areas)

Before beginning calibration attach the SEC 3000 Calibration Adaptor (PN 1421468) to the SEC 3000 sensor housing. The zero and span gas flow should be regulated to 1.0 liter per minute (LPM).

Zeroing the SEC 3000

Apply clean air or zero air (nitrogen for oxygen sensor).

Connect calibration wire (white wire on SEC 3000) to negative (black wire of SEC 3000, common of the power supply) for ten (10) seconds, upon release the sensor will automatically enter the zero calibration routine. The electronics will automatically adjust the sensor's signal to the new zero reference level. During the zero calibration routine, the current output of the SEC 3000 will briefly go to 2.2 mA. Although this can be accomplished manually, installation of a switch (contact closure) can accomplish the zeroing procedure. It is recommended that this switch be a momentary type switch to prevent it from inadvertently being left in the calibrate position. If after 20 seconds the calibration lead has not been removed from common, the SEC 3000 will ignore the signal and continue operation as normal.

Spanning the SEC 3000

Apply the correct span gas concentration to the sensor (20.9% volume of O₂ for oxygen sensor).

Connect calibration wire (white wire on SEC 3000) to positive (red wire of SEC 3000, +24 VDC of the power supply) for ten (10) seconds; upon release the sensor will automatically enter the span calibration routine. The electronics will automatically adjust the sensor's signal to the new span reference level. During the span calibration routine, the current output of the SEC 3000 will briefly go to 2.0 mA. Although this can be accomplished manually, installation of a switch (contact closure) can accomplish the spanning procedure. It is recommended that this switch be a momentary type switch to prevent it from inadvertently being left in the calibrate position. If after 20 seconds the calibration lead has not been removed from +24 VDC, the SEC 3000 will ignore the signal and continue operation as normal.

V. MAINTENANCE

The SEC 3000 does not normally require routine maintenance other than calibration. The only consumable item on the SEC 3000 is the sensing element. The toxic gas sensing element will typically last for 2 years of operation.

To ensure the SEC 3000 is working properly, a “bump” test can be performed by using a known concentration of target gas and applying it to the sensor. If the sensor reads the correct value, the sensor is working properly.

Before servicing the SEC3000, ensure the environment is safe and free of toxic/explosive gas.

VI. Parts List

Part Number	Description
1420636	SEC 3000 PC Link software package
1901007	Sensor Separation Kit
1421468	Cal Adapter
1421467	Splash Guard
1421467	Sample Draw Adapter

VII. Drawing Section

Figure # _____ Title _____

Figure 1 Wiring Diagram, SEC 3000
 Figure 2 SEC Sensor Separation Kit


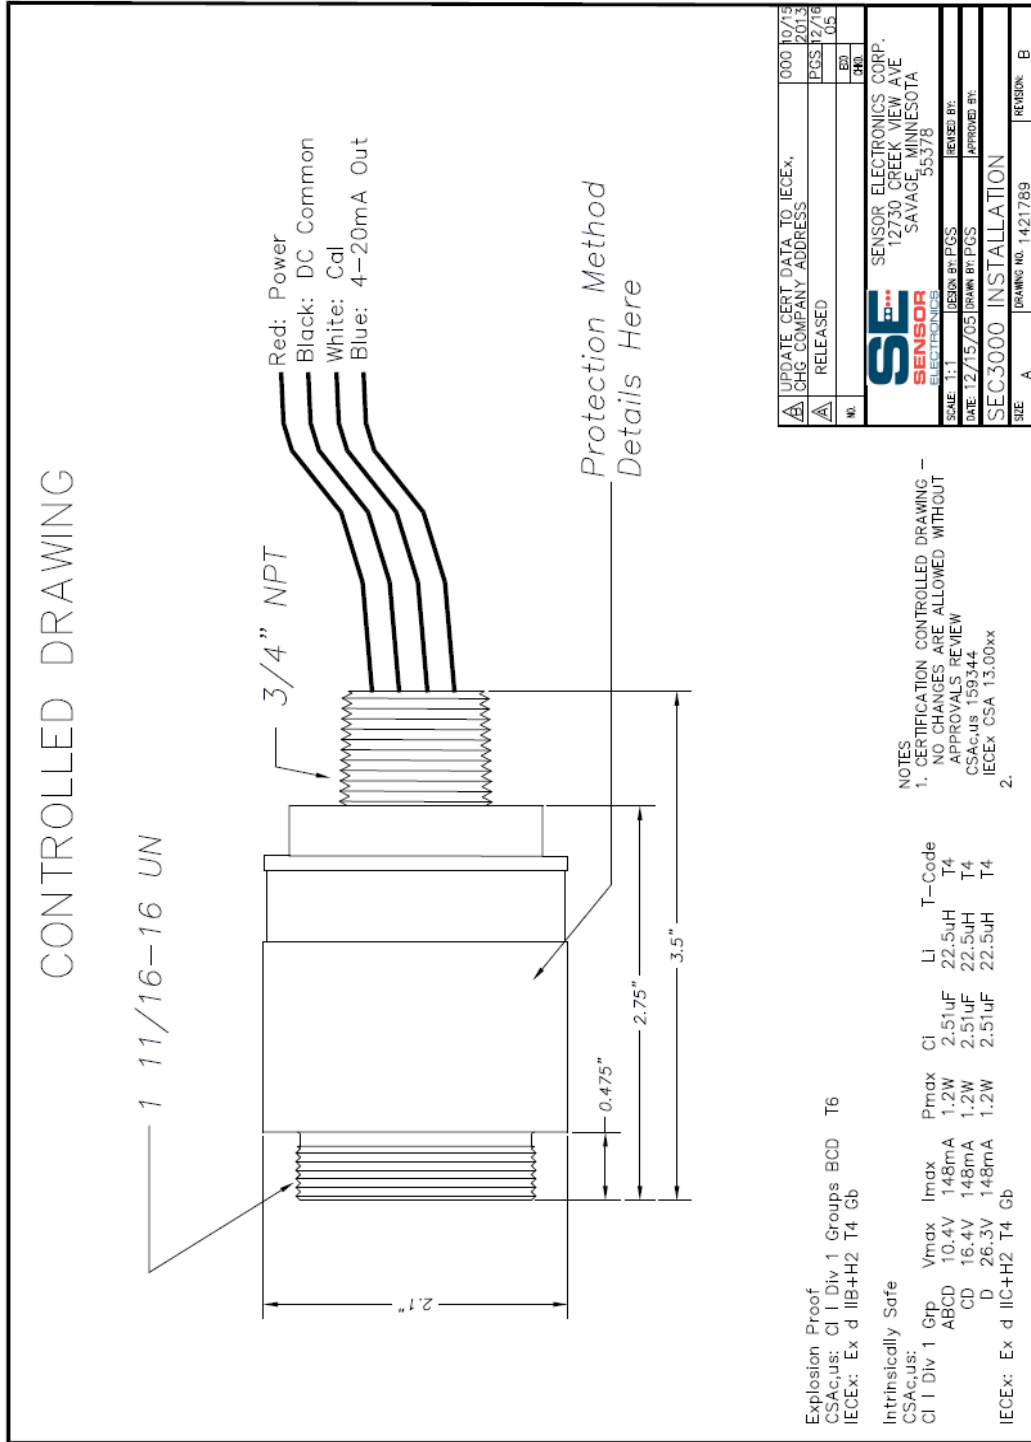


Figure 1

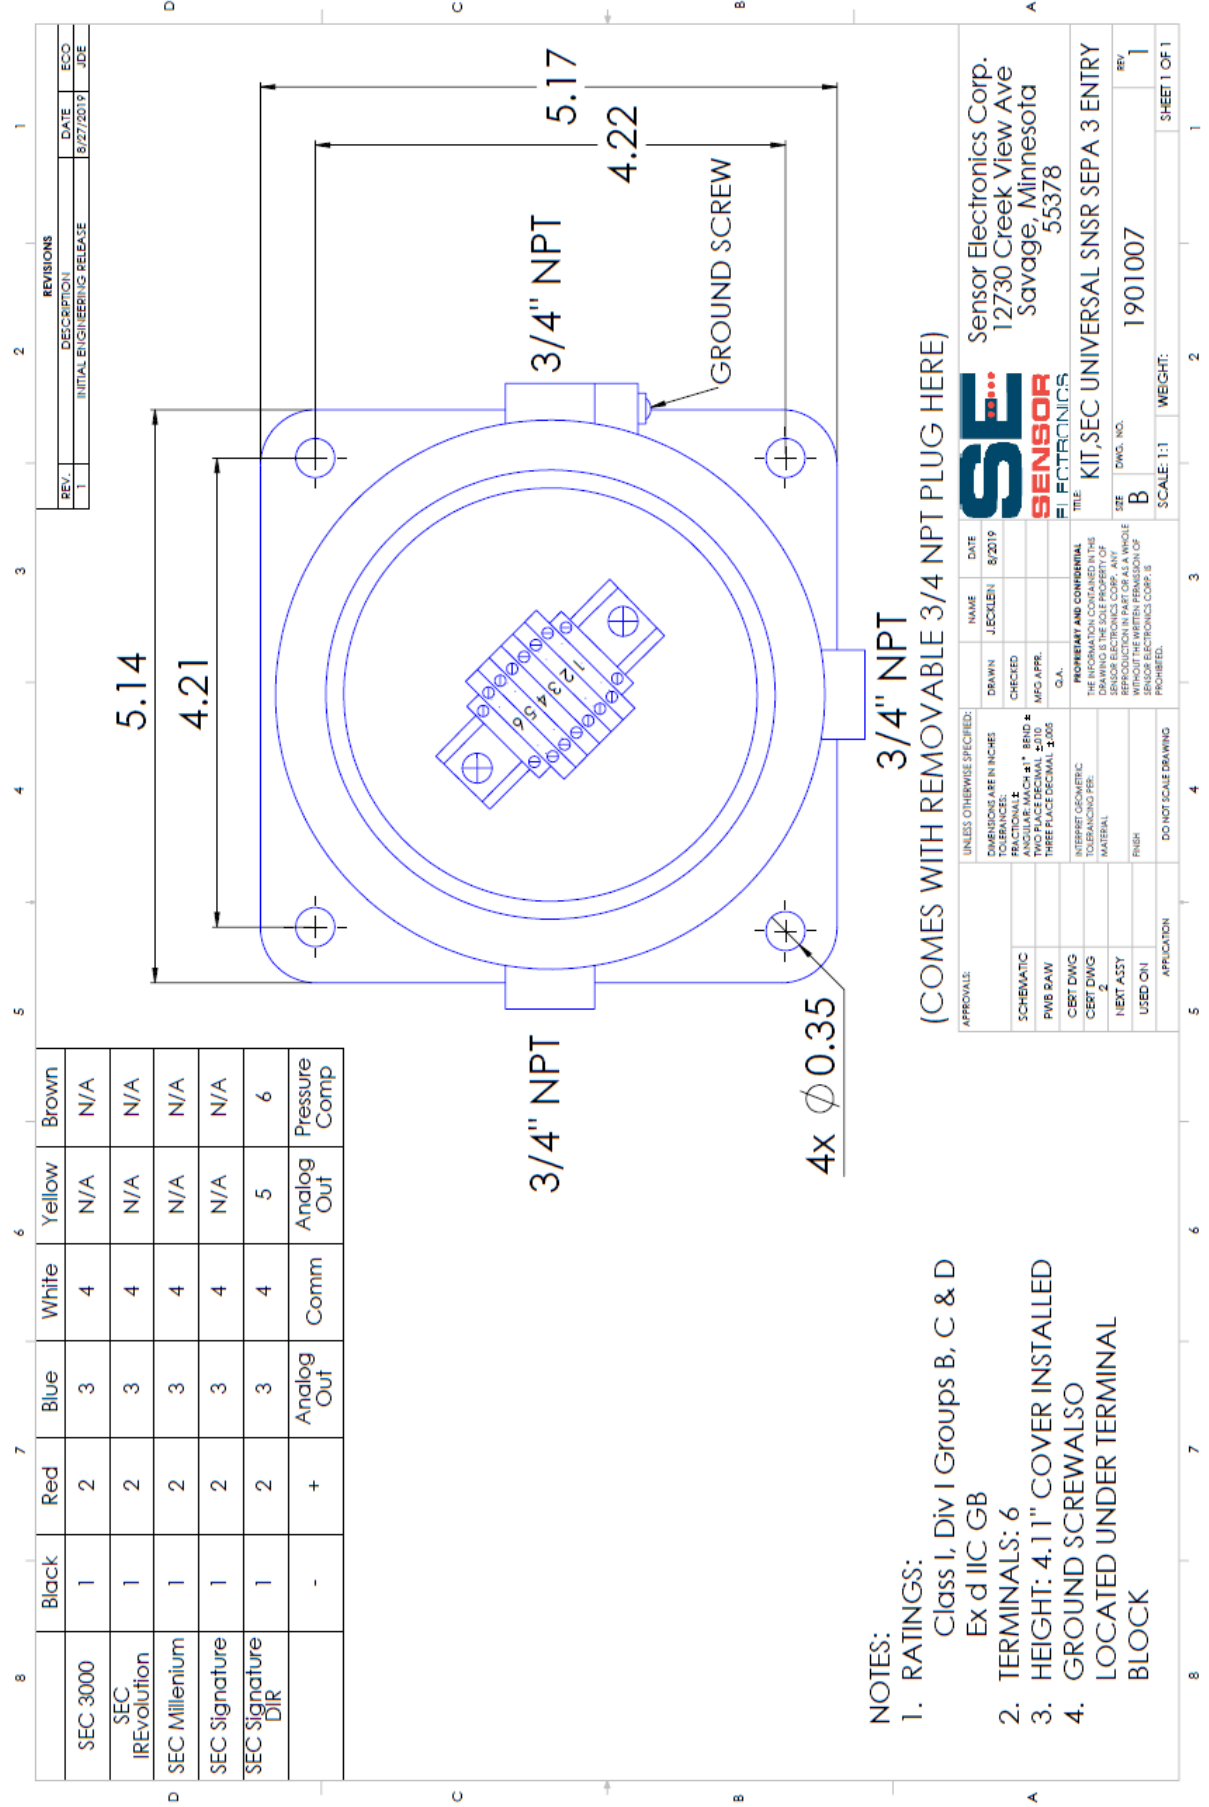

	Black	Red	Blue	White	Yellow	Brown
SEC 3000	1	2	3	4	N/A	N/A
SEC IREvolution	1	2	3	4	N/A	N/A
SEC Millennium	1	2	3	4	N/A	N/A
SEC Signature	1	2	3	4	N/A	N/A
SEC Signature DIR	1	2	3	4	5	6
	-	+	Analog Out	Comm	Analog Out	Pressure Comp

- NOTES:
- RATINGS:
Class I, Div I Groups B, C & D
Ex d IIC GB
 - TERMINALS: 6
 - HEIGHT: 4.11" COVER INSTALLED
 - GROUND SCREW ALSO LOCATED UNDER TERMINAL BLOCK

(COMES WITH REMOVABLE 3/4 NPT PLUG HERE)

UNLESS OTHERWISE SPECIFIED:		NAME	DATE
DIMENSIONS ARE IN INCHES		J. ECKLEN	8/2019
TOLERANCES:		DRAWN	CHECKED
FRACTIONS: 1/16"			
DECIMALS: 1/100"			
TWO PLACE DECIMAL: ±0.02			
THREE PLACE DECIMAL: ±0.005			
O.A.			
SCHEMATIC			
PWB RAW			
CERT DWG			
CERT DWG			
NEXT ASSY			
USED ON			
APPLICATION			
DO NOT SCALE DRAWING			
TITLE		KIT, SEC UNIVERSAL SNSR SEPA 3 ENTRY	
DRAWING NO.		1901007	
REV		1	
SCALE		1:1	
WEIGHT		SHEET 1 OF 1	

SENSOR ELECTRONICS
 Sensor Electronics Corp.
 12730 Creek View Ave
 Savage, Minnesota
 55378

Figure 2

Part Number Construction

	Gas Type	Range	Units	Wire/Cable	Wire Length
30	XX	XXXX	X	X	XXX

	Range Value (4 Places)	M: PPM	0: Wires	Inches Length Or S: Standard Length (24")
		B: PPB	1: Cable	
		V: % Vol		
		L: %LEL		
B2H6: 32				
AsH3: 32				
BCl3: 21				
BF3: 23				
Cl2: 11				
ClF3: 23				
CO: 16				
DCS: 21				
F2: 13				
H2: 18				
H2S: 24				
HBr: 23				
HCl: 21				
HF: 23				
NH3: 15				
O2: 19				
PH3: 32				
SiH4: 33				
SO2: 27				
TiCl4: 21				
WF6: 23				

Example: 0-100PPM Carbon Monoxide with 36 inches of wire
P/N: 30160100M036